

# Centauri® Condensing Boiler

## Model: 850 WB 250A-IFC

Full modulation  
< 20 ppm NOx throughout turndown




Max. Input Btu/h	850,000
* Max. Output Btu/h	765,000
** Minimum Inlet Flow Gas Pressure	4.5" W.C.
Maximum Static Gas Pressure	14" W.C.

\* Output per DOE, 10 CFR 431

Shipping Wt - Lbs	2220
Operating Wt - Lbs	3720

### Performance Chart

----- Low Fire  
———— High Fire

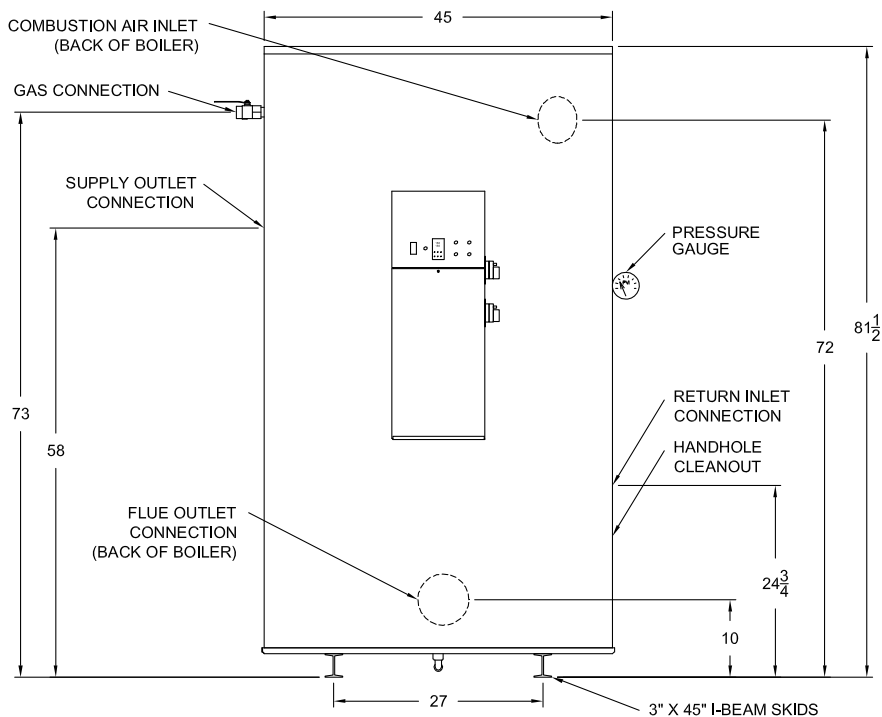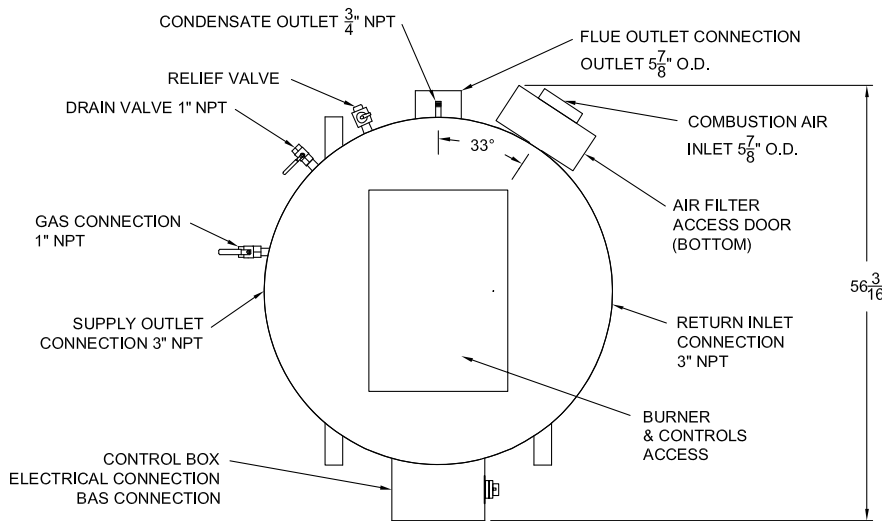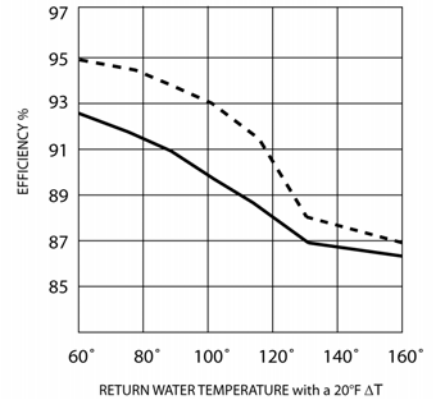

### Standard Electrical

120V, 1Ø, 60 Hz., 15 amp circuit

### Optional Electrical

240V, 1Ø, 60 Hz., 10 amp circuit  
120V control circuit

208/230V, 3Ø, 60 Hz. 6 amps  
480V, 3Ø, 60 Hz. 3.0 amps  
120V control circuit required  
120V transformer optional

### Venting

Use an ETL, UL, ULC or CSA listed Category IV, 6" stainless steel vent, minimum distance 5 ft., maximum distance 100 eq. ft. Longer vents, ETL listed w/larger diameters, see I&M.

### Inlet Combustion Air

Up to 100 eq. ft. using 6" PVC or galvanized vent pipe. Longer lengths, ETL listed w/larger diameters, see I&M.

### \*\* Alternate Gas Pressure

For < 4.5"W.C., consult factory

### Minimum Service Clearances

18" from sides, 24" from front and top

### Emissions

399,000 to 900,000 BTU  
< 20 ppm NOx



RIVERSIDE HYDRONICS, LLC · FORT WORTH, TEXAS · (800) 990-5918

www.riversidehydronics.com



34-925 04.11