

# Centauri® Condensing Boiler



## Model: 1500 WB 250A-IFC

Full modulation  
< 10 ppm NOx throughout turndown


Max. Input Btu/h	1,500,000
* Max. Output Btu/h	1,290,000
** Minimum Inlet Flow Gas Pressure	4.5" W.C.
Maximum Static Gas Pressure	14" W.C.

\* Output per DOE, 10 CFR 431

Shipping Wt - Lbs	2320
Operating Wt - Lbs	3550

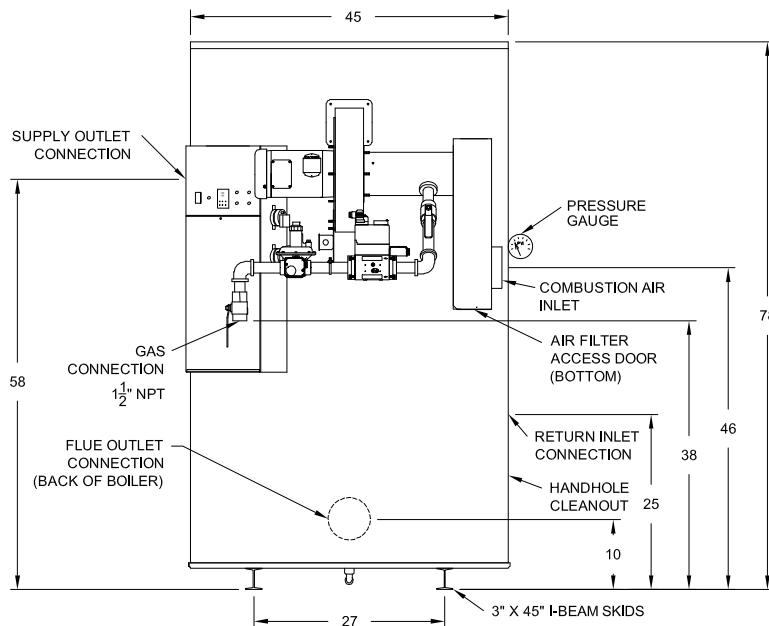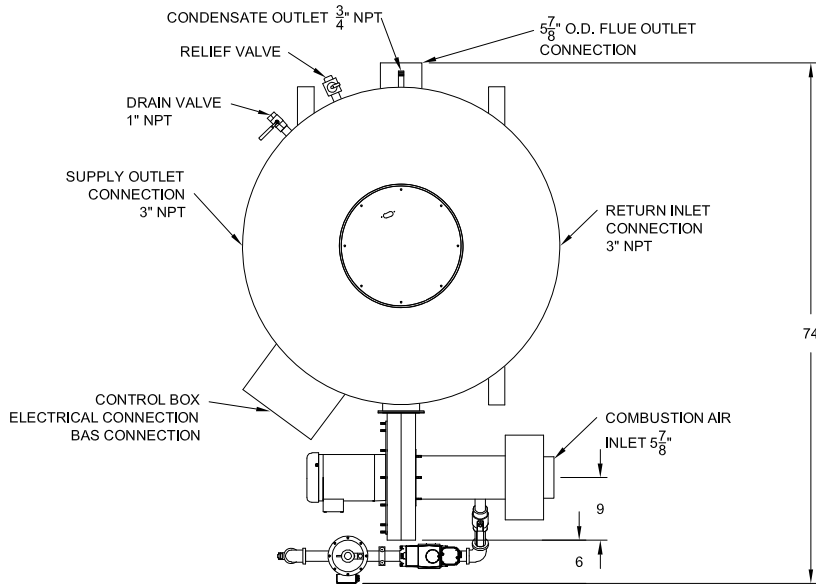

CENTAURI BOILER EFFICIENCY CURVES  
with 20°F Temperature Rise

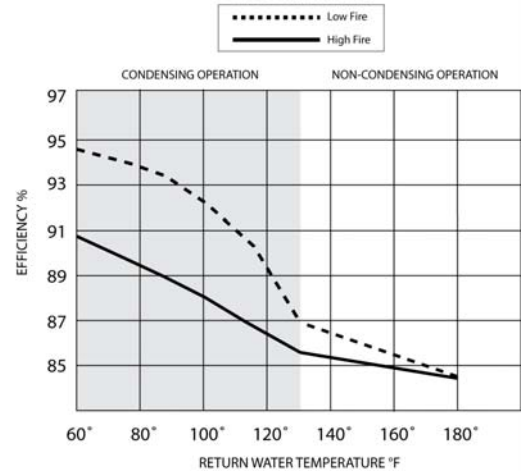

### Standard Electrical

120V, 1Ø, 60 Hz., 20 amp circuit

### Optional Electrical

240V, 1Ø, 60 Hz., 15 amp circuit  
120V control circuit

208/230V, 3Ø, 60 Hz. 9 amps  
480V, 3Ø, 60 Hz. 4.5 amps  
120V control circuit required  
120V transformer optional

### Venting

Use an ETL, UL, ULC or CSA listed Category IV, 6" stainless steel vent, minimum distance 5 ft., maximum distance 100 eq. ft. Longer vents, ETL listed w/larger diameters, see I&M.

### Inlet Combustion Air

Up to 100 eq. ft. using 6" PVC or galvanized vent pipe. Longer lengths, ETL listed w/larger diameters, see I&M.

### \*\* Alternate Gas Pressure

For < 4.5"W.C., consult factory

### Minimum Service Clearances

18" from sides, 24" from front and top

### Emissions

All BTU inputs:  
< 10 ppm NOx